

VERSION JAN 2012

FOR OFFICE USE ONLY

Non-Standard Installation Approval Form

TO: Environment Canterbury
C/o Water Metering Team
4 McNally Street
PO Box 419
Ashburton 7700

Ph:03 308 7682
Fax: 03 365 3194
Email: water.metering@ecan.govt.nz

If a water meter installation can not comply with Environment Canterbury standards, then a request for non-standard installation needs to be submitted. This form needs to be completed and submitted to the relevant compliance section. Please also complete the flow meter data logger installation and commissioning certificate which includes fields for data logger details and accuracy details.

Consent Holder: _____

Consent number: CRC _____ Well/SWAP number(s): _____


Proposed Flowmeter details:

Make: _____ Meter size: _____ (mm diameter)

Model: _____ Pulse output: **Yes / No**

Reason(s) for Non-Standard Installation: _____

Figure 1: Installation diagram - Please mark any disturbances upstream of the flowmeter e.g. pipe size reduction, gate valves, pipe bends.

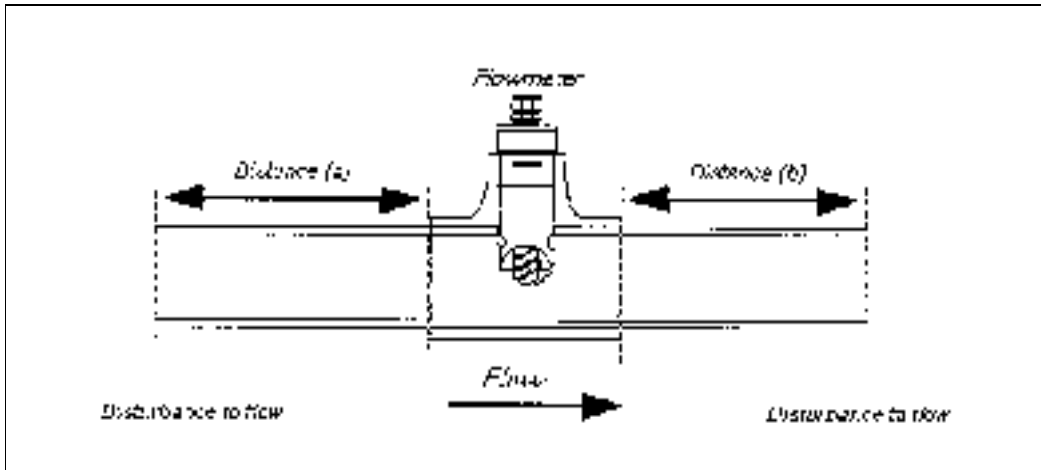

Information to be provided with application:

The following information is to be attached to the application.

- A letter from the meter manufacturer/supplier confirming that the meter will operate within the required accuracy within the non-standard pipe run.
- A picture(s) of the current installation.
- A location map showing where a 15 diameters length of straight unobstructed accessible pipe run is available to verify the system flow with a clamp-on flow meter. The map should show the approximate location of this section of pipe in proximity to the installed water meter.
- Approximate timeline for installation (i.e. when by?). Date: _____

Installer Contact Details:

Company: _____

Contact Person: _____ Email: _____

Phone No: _____ Mobile No: _____

Date: _____